Easy UPS 3L

Operation

10/2020

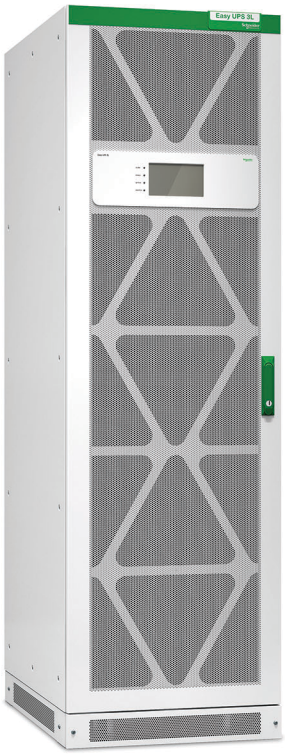

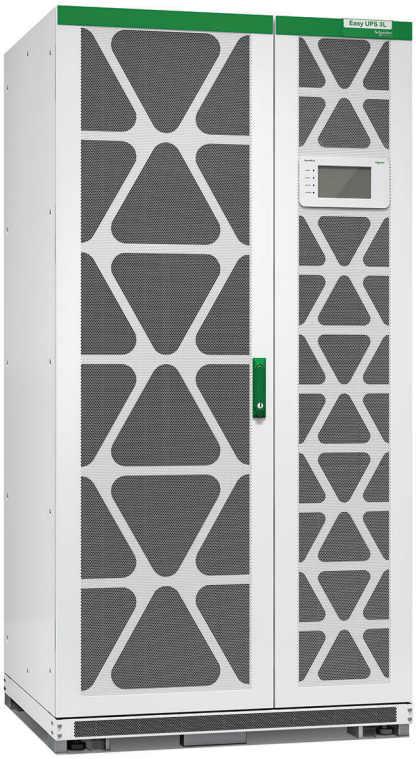

www.se.com

Legal Information

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this guide are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owners.

This guide and its content are protected under applicable copyright laws and furnished for informational use only. No part of this guide may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the guide or its content, except for a non-exclusive and personal license to consult it on an "as is" basis. Schneider Electric products and equipment should be installed, operated, serviced, and maintained only by qualified personnel.

As standards, specifications, and designs change from time to time, information contained in this guide may be subject to change without notice.

To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this material or consequences arising out of or resulting from the use of the information contained herein.

Go to *http://www.productinfo.schneider-electric.com/portals/ui/easyups3l/* for translations.
Rendez-vous sur *http://www.productinfo.schneider-electric.com/portals/ui/easyups3l/* pour accéder aux traductions.
Vaya a *http://www.productinfo.schneider-electric.com/portals/ui/easyups3l/* para obtener las traducciones.
Gehe zu *http://www.productinfo.schneider-electric.com/portals/ui/easyups3l/* für Übersetzungen.
Vai a *http://www.productinfo.schneider-electric.com/portals/ui/easyups3l/* per le traduzioni.
Vá para *http://www.productinfo.schneider-electric.com/portals/ui/easyups3l/* para obter as traduções.
Перейдите по ссылке *http://www.productinfo.schneider-electric.com/portals/ui/easyups3l/* для просмотра переводов.
前往 *http://www.productinfo.schneider-electric.com/portals/ui/easyups3l/* 查看译文。

Table of Contents

Important Safety Instructions — SAVE THESE INSTRUCTIONS 5
- Electromagnetic Compatibility 6
- Safety Precautions 6

Overview 7
- User Interface 7
  - Status LEDs 7
- Remote EPO 7
- Display Menu Tree 8
- Overview of Single UPS 9
- Overview of 1+1 Redundant Parallel System with Common Battery Bank 10
- Overview of Parallel System 11

Operation Modes 12

Operation Procedures 16
- View System Status Information 16
- Start Up a Single UPS in Normal Mode 17
- Transfer a Single UPS from Normal Mode to Static Bypass Mode 19
- Transfer a Single UPS from Static Bypass Mode to Normal Mode 19
- Transfer a Single UPS from Normal Mode to Maintenance Bypass Mode 20
- Transfer a Single UPS from Maintenance Bypass Mode to Normal Mode 20
- Transfer a Parallel System from Normal Mode to Maintenance Bypass Mode 21
- Transfer a Parallel System from Maintenance Bypass Mode to Normal Mode 22
- Isolate a Single UPS from the Parallel System 23
- Start Up and Add a UPS to a Running Parallel System 24

Configuration 25
- Default Settings 25
- Set the Display Language 26
- Configure the Display Settings 27
- Configure the Network Settings 27
- Change the Display Password 28
- Set the Date and Time 28
- Configure the UPS Settings 29
- Configure the Output Settings 30
- Configure the Battery Settings 31
- Configure the Input Contacts and Output Relays 33
- Configure Life Cycle Monitoring 36
- Enable/Disable Buzzer 36

Maintenance 37
- Parts Replacement 37
  - Determine if you need a Replacement Part 37
- Replace the Air Filter 37

Troubleshooting 40

View the Active Alarms.....40
Clear Alarm.....40
View the Log 40
Calibrate the Display.....41

Important Safety Instructions — SAVE THESE INSTRUCTIONS

Read these instructions carefully and look at the equipment to become familiar with it before trying to install, operate, service or maintain it. The following safety messages may appear throughout this manual or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.

The addition of this symbol to a “Danger” or “Warning” safety message indicates that an electrical hazard exists which will result in personal injury if the instructions are not followed.

This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages with this symbol to avoid possible injury or death.

⚠DANGER

DANGER indicates a hazardous situation which, if not avoided, **will result in** death or serious injury.

Failure to follow these instructions will result in death or serious injury.

⚠WARNING

WARNING indicates a hazardous situation which, if not avoided, **could result in** death or serious injury.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

⚠CAUTION

CAUTION indicates a hazardous situation which, if not avoided, **could result in** minor or moderate injury.

Failure to follow these instructions can result in injury or equipment damage.

NOTICE

NOTICE is used to address practices not related to physical injury. The safety alert symbol shall not be used with this type of safety message.

Failure to follow these instructions can result in equipment damage.

Please Note

Electrical equipment should only be installed, operated, serviced, and maintained by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

A qualified person is one who has skills and knowledge related to the construction, installation, and operation of electrical equipment and has received safety training to recognize and avoid the hazards involved.

Electromagnetic Compatibility

NOTICE

RISK OF ELECTROMAGNETIC DISTURBANCE

This is a product Category C3 according to IEC 62040-2. This is a product for commercial and industrial applications in the second environment - installation restrictions or additional measures may be needed to prevent disturbances. The second environment includes all commercial, light industry, and industrial locations other than residential, commercial, and light industrial premises directly connected without intermediate transformer to a public low-voltage mains supply. The installation and cabling must follow the electromagnetic compatibility rules, e.g.:

- the segregation of cables,
- the use of shielded or special cables when relevant,
- the use of grounded metallic cable tray and supports.

Failure to follow these instructions can result in equipment damage.

Safety Precautions

⚠⚠DANGER

HAZARD OF ELECTRICAL SHOCK, EXPLOSION OR ARC FLASH

All safety instructions in this document must be read, understood and followed.

Failure to follow these instructions will result in death or serious injury.

⚠⚠DANGER

HAZARD OF ELECTRICAL SHOCK, EXPLOSION OR ARC FLASH

After the UPS system has been electrically wired, do not start up the system. Start-up must only be performed by Schneider Electric.

Failure to follow these instructions will result in death or serious injury.

Overview

User Interface

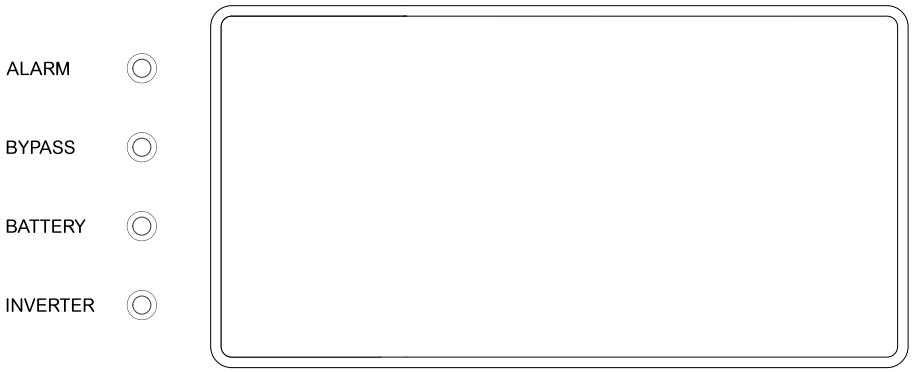

Status LEDs

LED	State	Description
ALARM	Steady or flashing red	Critical alarm
	Steady or flashing yellow	Warning alarm
	Off	No alarm condition
BYPASS	Steady yellow	The load is supplied by the bypass source
	Flashing yellow	There is an alarm condition on the bypass source
	Off	The load is not supplied by the bypass source
BATTERY	Steady yellow	The load is supplied by the battery source
	Flashing yellow	The battery source is unavailable
	Off	The load is not supplied by the battery source
INVERTER	Steady green	Inverter on
	Off	Inverter off

Remote EPO

Only use the remote EPO in case of emergency.

When the remote EPO is activated, the UPS will:

- By default: Turn off the rectifier, inverter, charger, and static bypass and stop supplying the load immediately, or
- Configurable: Transfer to static bypass mode and keep supplying the load.

⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

The UPS control circuit will remain active after the remote EPO has been activated if input is available.

Failure to follow these instructions will result in death or serious injury.

Display Menu Tree

- **Status**
  - **Input**
  - **Output**
  - **Battery**
  - **Bypass**
  - **Status information**
  - **UPS information**
- **Alarms**
  - **Active alarm(s)**
  - **Enable buzzer/Disable buzzer**
  - **Logs**
- **Settings**
  - **General settings**
    - **Language settings**
    - **Display settings**
    - **Network**
    - **Password settings**
    - **Date and time**
  - **Advanced settings**
    - **System settings**
    - **Output settings**
    - **Bypass settings**
    - **Parallel settings**
    - **Battery settings**
    - **Contacts and relays**
- **Service**
  - **Display calibration**
  - **LCM settings**
- **Control**
  - **Inverter ON/OFF**
    - **Turn single INV ON**
    - **Turn single INV OFF**
    - **Turn par. INV ON**
    - **Turn par. INV OFF**
  - **Clear alarm(s)**
  - **Self-test**
- **About**
- **Login**
  - **Settings**
  - **Restore**
  - **Clear log**

Overview of Single UPS

Single Mains System

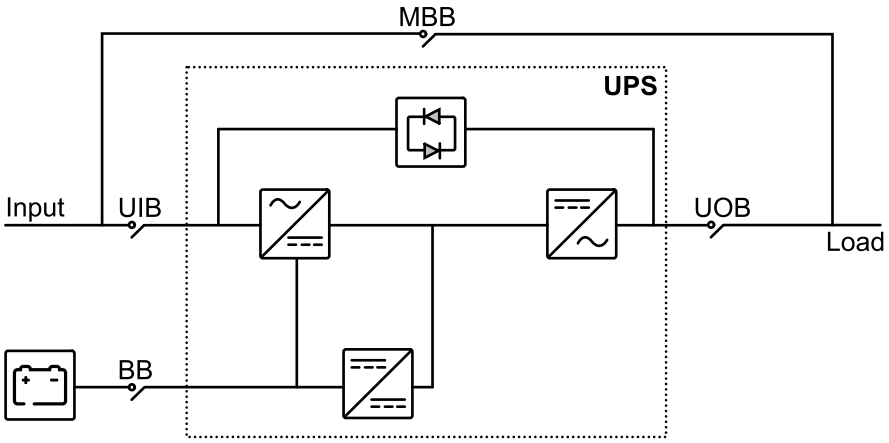

Dual Mains System

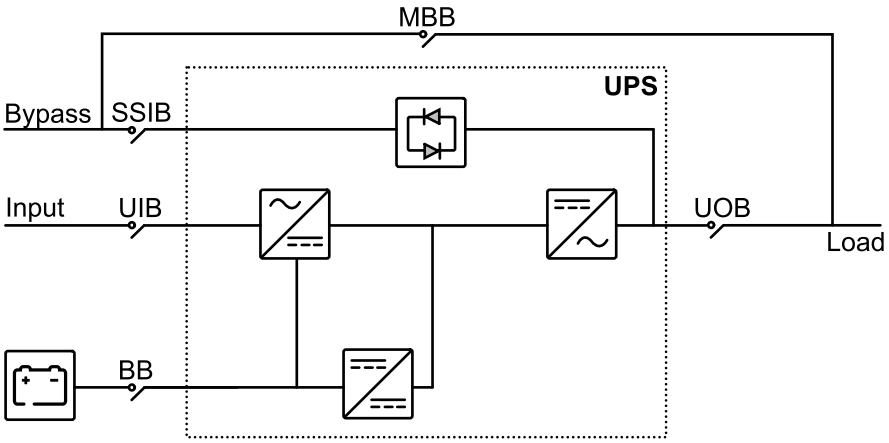

UIB	Unit input breaker
SSIB	Static switch input breaker
UOB	Unit output breaker
MBB	Maintenance bypass breaker
BB	Battery breaker

Overview of 1+1 Redundant Parallel System with Common Battery Bank

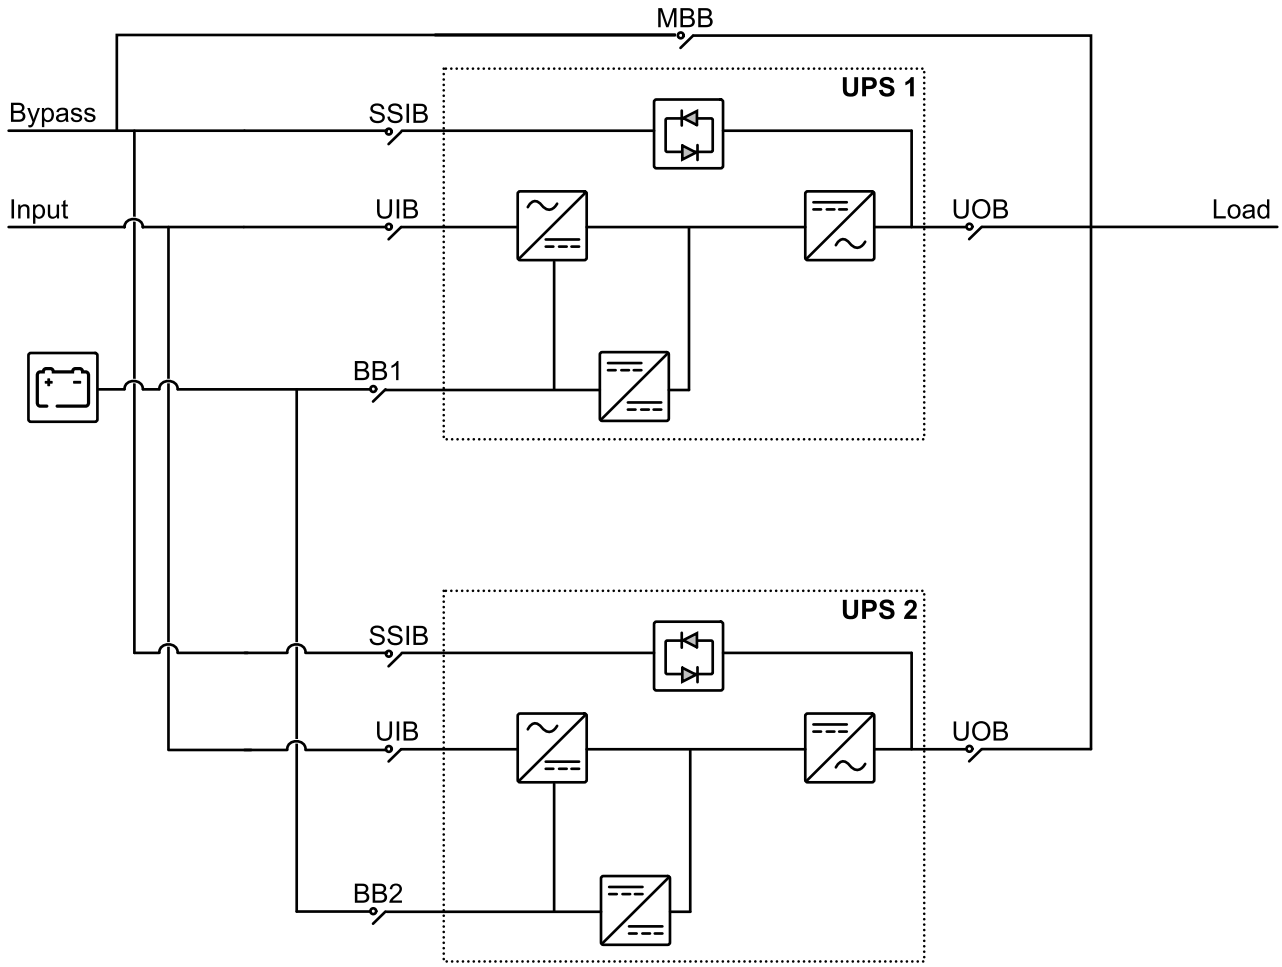

UIB	Unit input breaker
SSIB	Static switch input breaker
UOB	Unit output breaker
MBB	Maintenance bypass breaker
BB1	Battery breaker 1
BB2	Battery breaker 2

Overview of Parallel System

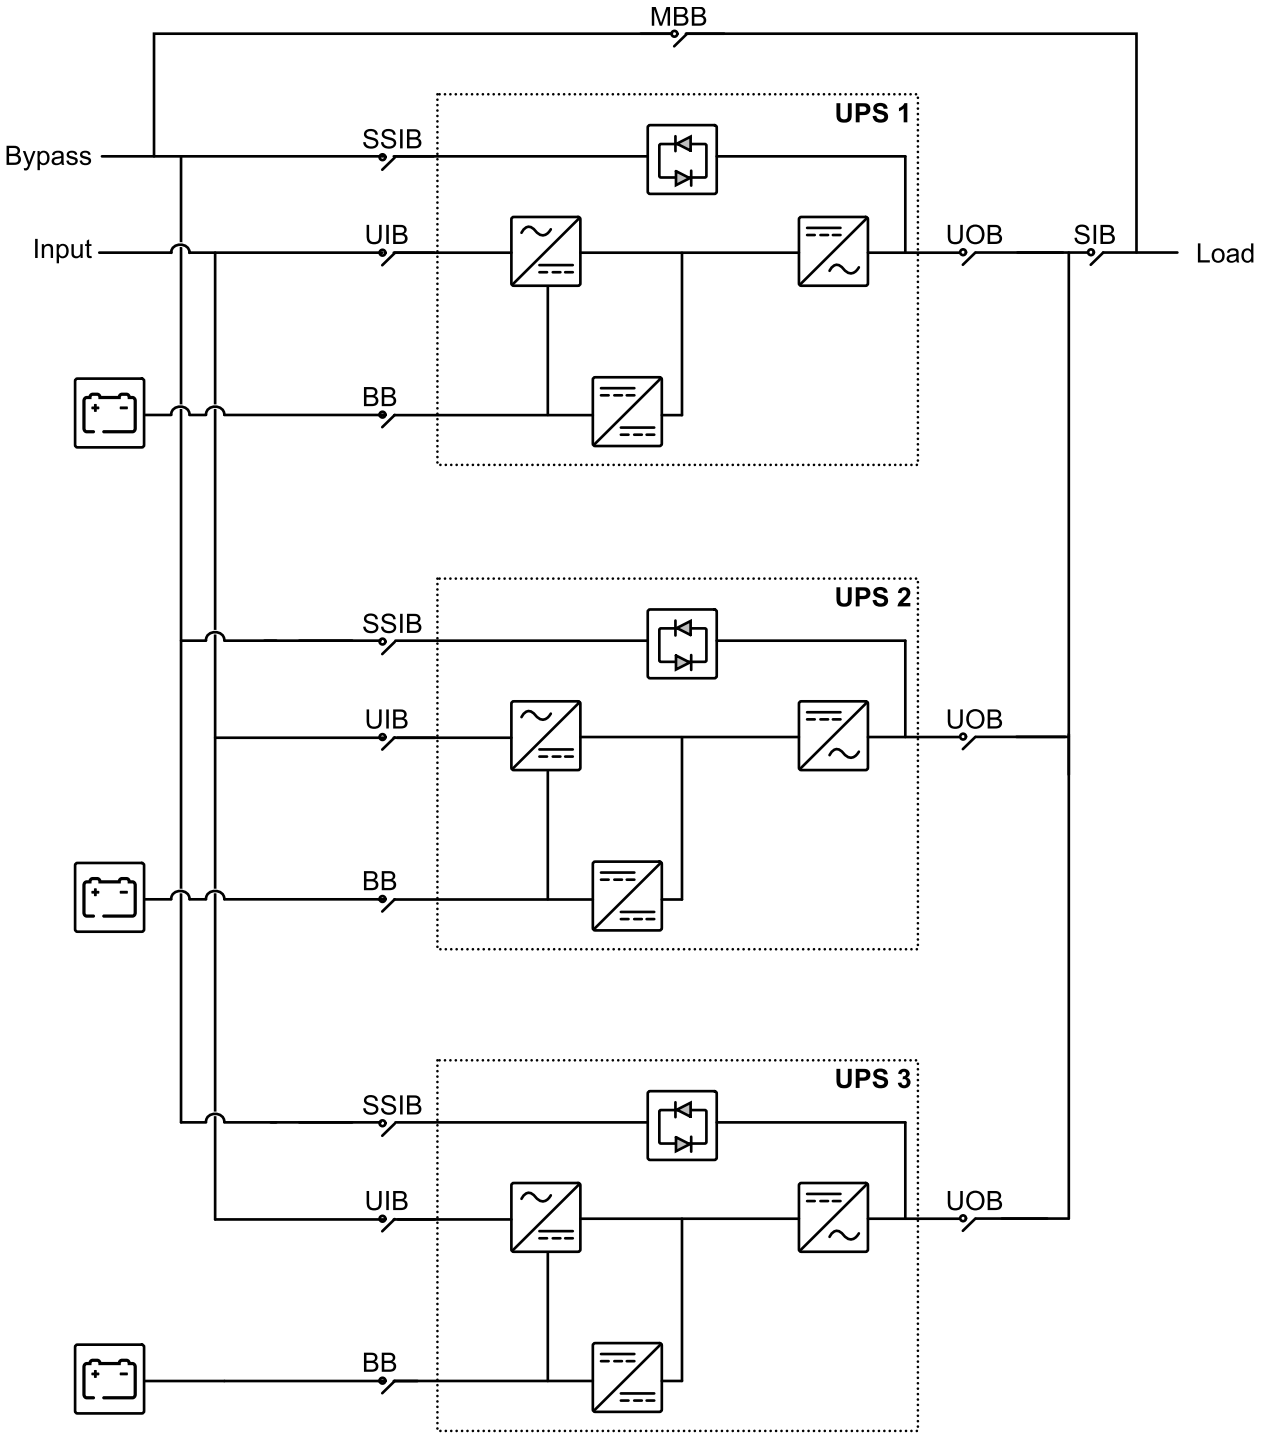

UIB	Unit input breaker
SSIB	Static switch input breaker
UOB	Unit output breaker
MBB	Maintenance bypass breaker
SIB	System isolation breaker
BB	Battery breaker

Operation Modes

Normal Mode

The UPS provides power to the connected load from mains. The UPS converts mains to conditioned power for the connected load while recharging the batteries (float or boost charge).

LED Status

ALARM

BYPASS

BATTERY

INVERTER

Power Flow

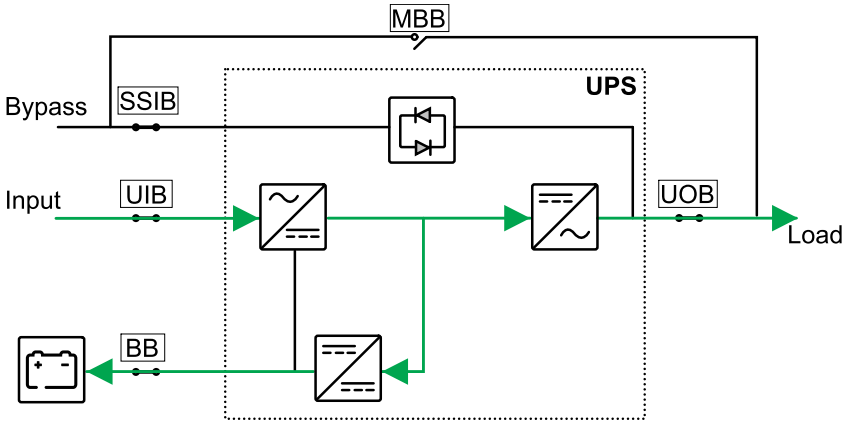

Battery Mode

The UPS transfers to battery mode if the mains supply fails. The UPS provides power to the connected load from the connected batteries for a finite period. When the mains supply returns, the UPS transfers back to normal mode.

LED Status

ALARM

BYPASS

BATTERY

INVERTER

Power Flow

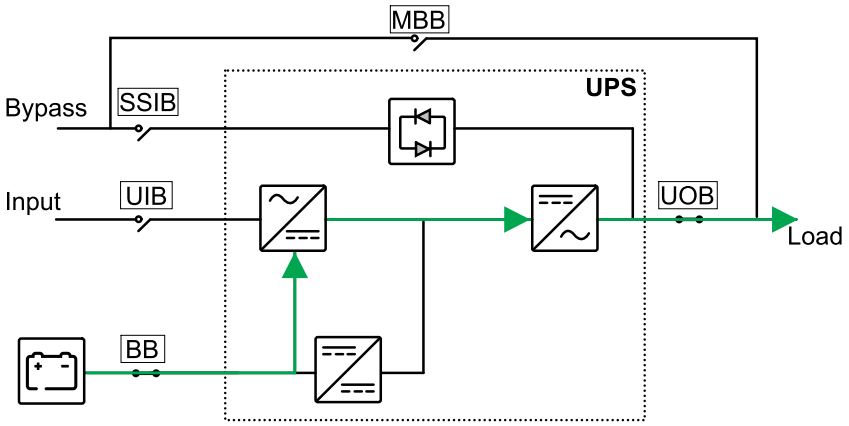

Static Bypass Mode

The UPS supplies the load with power from the bypass source. If the conditions for normal or battery mode are not met, the load will be transferred from the inverter to the bypass source with no interruption in power to the load.

LED Status

ALARM

BYPASS

BATTERY

INVERTER

Power Flow

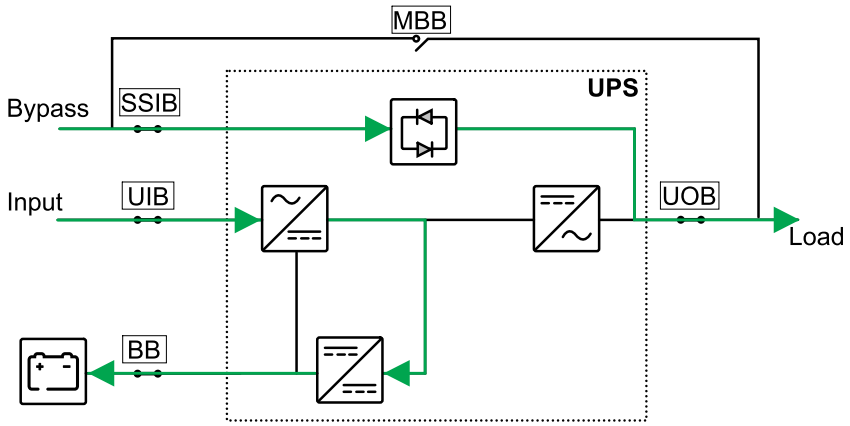

Maintenance Bypass Mode

In maintenance bypass mode, the mains is sent via the maintenance bypass breaker (MBB) to the load. Battery backup is not available in maintenance bypass mode.

LED Status

ALARM

BYPASS

BATTERY

INVERTER

Power Flow

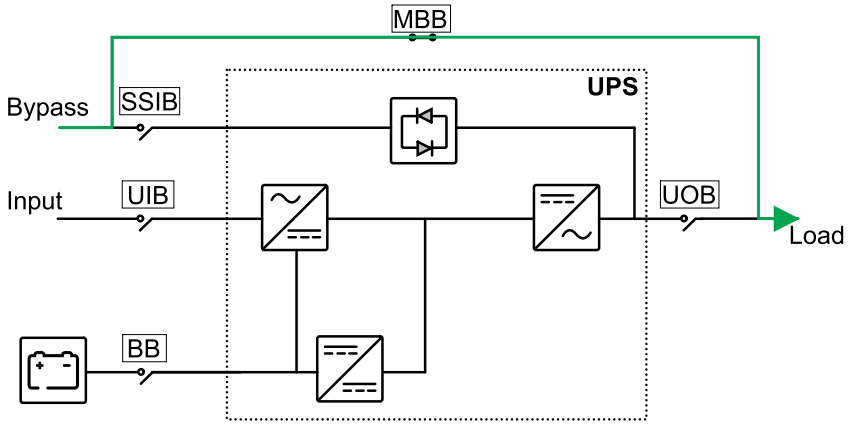

ECO Mode

In ECO mode the UPS is configured to use static bypass mode as the preferred operation mode under predefined circumstances. The inverter is in standby in ECO mode and in case of interruption to the mains, the UPS transfers to battery mode and the load is supplied from the inverter.

LED Status

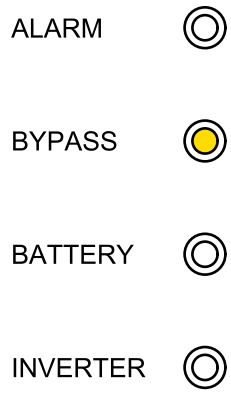

Power Flow

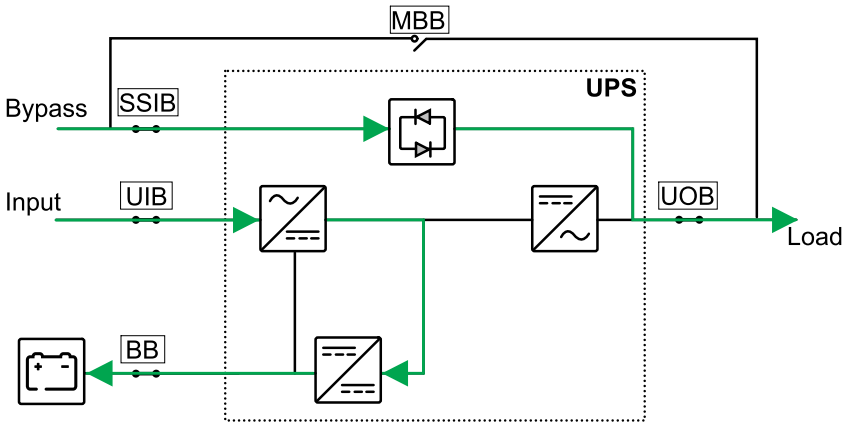

Frequency Converter Mode

In frequency converter mode, the UPS presents a stable output frequency (at 50 or 60 Hz) and the static bypass switch is not available.

NOTICE

RISK OF EQUIPMENT DAMAGE OR LOAD DROP

In frequency converter mode the UPS cannot run in static bypass or maintenance bypass mode. Before turning the UPS into frequency converter mode, you must contact a Schneider Electric-certified partner to make sure that:

- the static switch input breaker SSIB and the maintenance bypass breaker MBB are in the OFF (opened) position (Schneider Electric strongly recommends to lock these with a padlock available from Schneider Electric)
- no cables are connected to the bypass terminals

Failure to follow these instructions can result in equipment damage.

NOTICE

RISK OF LOAD DROP

When the unit output breaker UOB is opened while the UPS is in frequency converter mode, the load will not be transferred, but will be dropped.

Failure to follow these instructions can result in equipment damage.

LED Status

ALARM

BYPASS

BATTERY

INVERTER

Power Flow

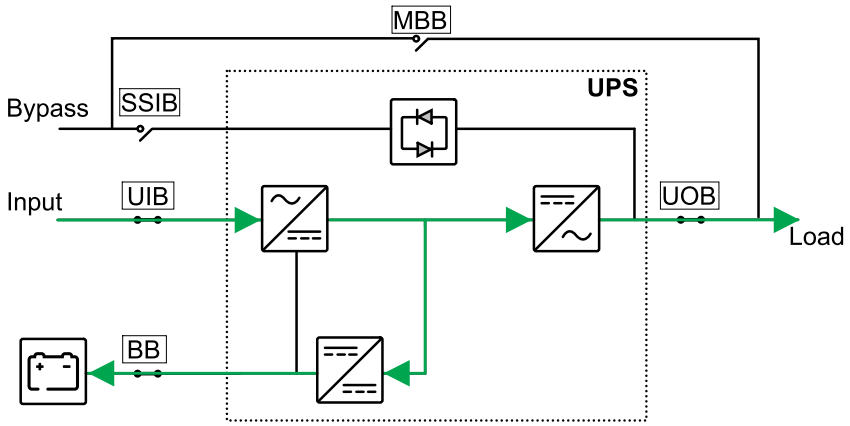

Autostart Mode

⚠⚠DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Always perform correct Lockout/Tagout before working on the UPS. A UPS with autostart enabled will automatically restart when the mains supply returns.

Failure to follow these instructions will result in death or serious injury.

When autostart is enabled, the UPS automatically restarts the inverter and bypass when the mains supply returns. By default autostart is enabled.

NOTE: If autostart is disabled, the inverter and bypass will not restart automatically when the mains return.

LBS Mode (Optional)

When LBS mode is enabled, the output of two independent UPS systems (single system or parallel systems) will be synchronized. This requires installation of synchronization cables between the two UPS systems. The synchronization of the output is not supported when both UPS systems are in static bypass mode or maintenance bypass mode.

Operation Procedures

View System Status Information

1. From the home screen of the display select **Status**.
2. You can now select to view status information for:
   - **Input**
   - **Output**
   - **Battery**
   - **Bypass**
   - **Status information**
   - **UPS information**

Start Up a Single UPS in Normal Mode

NOTE: When the UPS starts up, any stored settings will be used.

1. Check that all breakers are in the OFF (open) position.
2. Turn the static switch input breaker SSIB to the ON (closed) position.

   The display turns on and the Home screen is shown.
3. Turn the unit output breaker UOB to the ON (closed) position.

   Wait approximately 30 seconds until the bypass LED turns steady yellow. The UPS starts up in static bypass mode.
4. Turn the unit input breaker UIB to the ON (closed) position.

   The rectifier ramps up. When the rectifier is ready, the inverter starts up and synchronizes with bypass.

   The LEDs on the user interface show as follows:

   ALARM

   BYPASS

   BATTERY

   INVERTER
5. Wait approximately 20 seconds until inverter LED turns steady green, the UPS transfers automatically from static bypass mode to normal mode.

   The LEDs on the user interface show as follows:

   ALARM

   BYPASS

   BATTERY

   INVERTER

   NOTE: The BATTERY LED will be flashing.

6. Turn the battery breaker(s) BB to the ON (closed) position.
   The LEDs on the user interface show as follows:

ALARM

BYPASS

BATTERY

INVERTER

Transfer a Single UPS from Normal Mode to Static Bypass Mode

1. From the home screen on the display select **Control > Inverter ON/OFF > Turn Single INV OFF**.

   The UPS transfers from normal to static bypass mode without an interruption to the load.

   The LEDs on the user interface show as follows:

   ALARM

   BYPASS

   BATTERY

   INVERTER

Transfer a Single UPS from Static Bypass Mode to Normal Mode

NOTE: The UPS will normally transfer automatically from static bypass to normal mode. This procedure can be used to manually transfer to normal mode if the bypass frequency or voltage is above the specified limits.

1. From the home screen of the display select **Control > Inverter ON/OFF > Turn Single INV ON**.

   The LEDs on the user interface show as follows:

   ALARM

   BYPASS

   BATTERY

   INVERTER

Transfer a Single UPS from Normal Mode to Maintenance Bypass Mode

1. From the home screen on the display select **Control > Inverter ON/OFF > Turn Single INV OFF**.
2. Turn the maintenance bypass breaker MBB to the ON (closed) position.

   The load is now supplied via the maintenance bypass breaker.
3. Turn the battery breaker(s) BB to the OFF (open) position.
4. Turn the unit input breaker UIB to the OFF (open) position.
5. Turn the static switch input breaker SSIB to the OFF (open) position.
6. Turn the unit output breaker UOB to the OFF (open) position.

⚠⚠DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Wait at least 5 minutes before removing the cover of the UPS after the display has turned off to allow for the capacitors to fully discharge.
- Always measure for hazardous voltages on all terminals before working on the UPS.

Failure to follow these instructions will result in death or serious injury.

Transfer a Single UPS from Maintenance Bypass Mode to Normal Mode

1. Check that all breakers except the maintenance bypass breaker MBB are in the OFF (open) position.
2. Turn the static switch input breaker SSIB to the ON (closed) position.

   The display turns on and the Home screen is shown.
3. Turn the unit output breaker UOB to the ON (closed) position.

   The UPS starts up in static bypass mode. Wait approximately 60 seconds until the bypass LED turns yellow.
4. Turn the unit input breaker UIB to the ON (closed) position.

   The rectifier ramps up.
5. Turn the battery breaker(s) BB to the ON (closed) position.
6. Turn the maintenance bypass breaker MBB to the OFF (open) position.

   The UPS automatically transfers to normal mode.

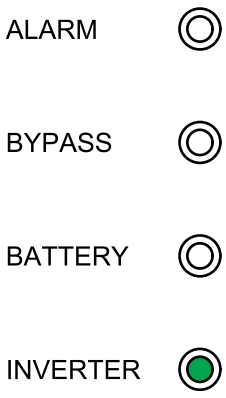

Transfer a Parallel System from Normal Mode to Maintenance Bypass Mode

1. From the home screen on the display select **Control > Inverter ON/OFF > Turn par. INV OFF**.

   All UPSs will turn to static bypass mode.

2. Turn the maintenance bypass breaker MBB to the ON (closed) position.

   The load is now supplied via the maintenance bypass breaker MBB.

3. Turn the battery breakers BB of all UPSs to the OFF (open) position.

4. Turn the unit input breakers UIB and the static switch input breakers SSIB of all UPSs to the OFF (open) position.

5. Turn the unit output breakers UOB of all UPSs and the system isolation breaker SIB to OFF (open) position.

⚠⚠DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Wait at least 5 minutes before removing the cover of the UPS after the display has turned off to allow for the capacitors to fully discharge.
- Always measure for hazardous voltages on all terminals before working on the UPS.

Failure to follow these instructions will result in death or serious injury.

Transfer a Parallel System from Maintenance Bypass Mode to Normal Mode

1. Check that:
   a. All UPS breakers (unit input breakers UIB, static switch input breakers SSIB, and unit output breakers UOB) and the system isolation breaker SIB are in the OFF (open) position.
   b. The battery breakers BB are in the OFF (open) position.
2. Turn the system isolation breaker SIB and the unit output breakers UOB of all UPSs to the ON (closed) position.
3. Turn the static switch input breakers SSIB of all UPSs to the ON (closed) position.

   Wait approximately 60 seconds until the bypass LED turns yellow.
4. Turn the maintenance bypass breaker MBB to the OFF (open) position.
5. Turn the unit input breakers UIB of all UPSs to the ON (closed) position.

   When the inverter LED turns steady green, the parallel system automatically transfers from static bypass to normal mode.
6. Turn the battery breakers of all UPSs to the ON (closed) position.

   The LEDs on the user interfaces show as follows:

   ALARM

   BYPASS

   BATTERY

   INVERTER

   The parallel system is now in normal mode.

Isolate a Single UPS from the Parallel System

Use this procedure to shut down one UPS in a running parallel system.

NOTE: Before initiating this procedure, ensure that the remaining UPS units can supply the load.

1. **Only for dual mains**: Turn the static switch input breaker SSIB of the UPS to the OFF (open) position.
2. From the home screen on the display select **Control > Inverter ON/OFF > Turn Single INV OFF**.
3. Turn the unit output breaker UOB of the UPS to the OFF (open) position.
4. Turn the unit input breaker UIB of the UPS to the OFF (open) position.
5. Turn the battery breaker(s) BB of the UPS to the OFF (open) position.

⚠⚠DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Wait at least 5 minutes before removing the cover of the UPS after the display has turned off to allow for the capacitors to fully discharge.
- Always measure for hazardous voltages on all terminals before working on the UPS.

Failure to follow these instructions will result in death or serious injury.

Start Up and Add a UPS to a Running Parallel System

Use this procedure to start up a UPS and add it to a running parallel system.

IMPORTANT: Before a UPS can be added to a parallel system, the parallel system must be configured by Schneider Electric.

1. On the new UPS check that:
   a. All UPS breakers (unit input breaker UIB, static switch input breaker SSIB, and unit output breaker UOB) are in the OFF (open) position.
   b. The battery breaker(s) BB are in the OFF (open) position.
2. Turn the unit input breaker UIB, the static switch input breaker SSIB, and the unit output breaker UOB of the UPS to the ON (closed) position.

   When the inverter LED turns steady green, the UPS has joined the running parallel system.

   The LEDs on the user interface show as follows:

   ALARM

   BYPASS

   BATTERY

   INVERTER

3. Turn the battery breaker(s) BB of the UPS to the ON (closed) position.
4. Verify correct load sharing between the parallel UPS units.

Configuration

Default Settings

Setting	Default Value	Available Settings
Display brightness	63	1-63
Backlight timeout (sec)	60	10-255
Device ID	1	1-255
Baud rate	9600	2400, 4800, 9600, 14400, 19200
Password timeout (minutes)	3	0-120
Date	2015-01-01	
Time	00:00:00	
Operation mode	**Single mode**	**Single mode**, **ECO mode**
Autostart	**Enable**	**Enable**, **Disable**
Self-aging load rate (%)	60	18-100
Frequency converter mode	**Disable**	**Disable**, **Enable**
LBS operation	**LBS disabled**	**LBS disabled**, **LBS master**, **LBS slave**
Transfer delay (sec)	1	0- 20
Par. transfer delay (sec)	10	0 -200
EPO transfers to bypass	**Disable**	**Disable**, **Enable**
Output frequency (Hz)	50	50, 60
Output voltage (V)	400	380, 400, 415
Output volt. compensation (%)	0.0	-5.0, -4.5, -4.0, -3.5, -3.0, -2.5, -2.0, -1.5, -1.0, -0.5, 0.0, 0.5, 1.0, 1.5, 2.0, 2.5, 3.0, 3.5, 4.0, 4.5, 5.0
Min. bypass RMS voltage (%)	-45	-10, -15, -20, -30, -45
Max. bypass RMS voltage (%)	15 at 415 V, 20 at 400 V, 25 at 380 V	10, 15, 20, 25
Bypass frequency range (%)	10	1, 2, 4, 5, 10
Output slew rate (Hz/sec)	0.5	0.5-2.0
Use bypass ON with overheated SCR	**Disable**	**Disable**, **Enable**
Allowed transfers to bypass	10	3-10
Parallel ID	1	1-6
Number of parallel UPSs	2	2-6
Number of par. redundant UPSs	0	0, 1, 2, 3, 4, 5
Strings in battery bank 1	1	1-12
Strings in battery bank 2	1	1-12
Strings in battery bank 3	1	1-12
Battery blocks per string	36	36, 38, 40, 42, 44, 46, 48, 50
Battery block capacity (Ah)	7	7-2000
Periodic boost charge (M)	0	0-24
Maximum charge current	0.1	0.05-0.2
Float voltage (V)	2.25	2.20-2.29
Boost voltage (V)	2.30	2.30-2.40
Boost charge duration (minutes)	240	0-999

Setting	Default Value	Available Settings
Float charge temp. compensation	0.000	0.000-0.007
Boost charge	**Disable**	**Enable**, **Disable**
Alarm for no battery connected	**Enable**	**Enable**, **Disable**
Common battery bank	**No**	**Yes**, **No**
External batt. breaker 1 status	**Enable**	**Disable**, **Enable**
External batt. breaker 2 status	**Enable**	**Disable**, **Enable**
External batt. breaker 3 status	**Enable**	**Disable**, **Enable**
Battery breaker trip	**Enable**	**Disable**, **Enable**
Backfeed on input	**Enable**	**Disable**, **Enable**
Backfeed on bypass	**Enable**	**Disable**, **Enable**
External MBB status	**Disable**	**Disable**, **Enable**
External SPD status	**Enable**	**Disable**, **Enable**
OUT 01	**Disable**	**Disable**, **Common alarm**, **In normal operation**, **On battery**, **Static bypass**, **Maintenance bypass**, **Output overload**, **Fan inoperable**, **Battery inoperable**, **Battery disconnected**, **Battery voltage low**, **Input out of tol.**, **Bypass out of tol.**, **EPO active**, **Charging**
OUT 02	**Disable**	
OUT 03	**Disable**	
OUT 04	**Disable**	
OUT 05	**Disable**	
OUT 06	**Disable**	
IN 01	**Disable**	**Disable**, **INV ON**, **INV OFF**, **Battery inoperable**, **Genset on**, **Custom alarm 3**, **Custom alarm 4**, **Disable ECO**, **Force INV OFF**, **Force charger OFF**
IN 02	**Disable**	
IN 03	**Disable**	
IN 04	**Disable**	
IN 05	**Disable**	
IN 06	**Disable**	
Self-test settings	**Disable auto self-test**	**Disable auto self-test**, **self-test every month**, **self-test every week**
Self-test every	**0 Day 0 hour 0 minute**	
Self-test type	**Customize**	**10 seconds**, **10 minutes**, **EOD**, **-10%**, **Customize**
Air filter check (months)	3	0, 3, 4, 5, 12
Air filter counter (days)	0	

Set the Display Language

1. From the home screen of the display select **Settings > General settings > Language settings**.
2. Select your preferred language.
3. Tap **Save settings**.

Configure the Display Settings

1. From the home screen of the display select **Settings > General settings > Display settings**.

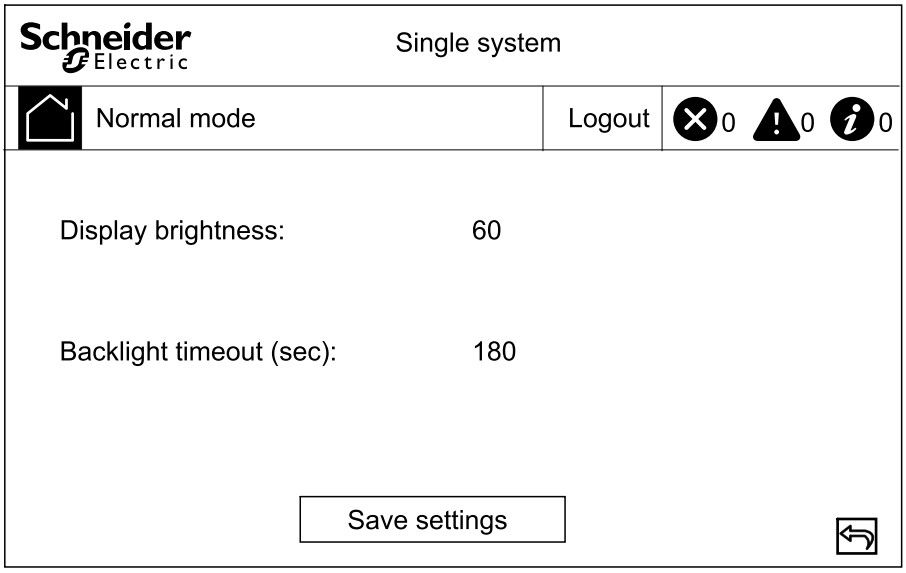

2. Set the **Display brightness** by choosing a value between 1 and 63.
3. Set the **Backlight timeout (sec)** by choosing a value between 10 and 255.
4. Tap **Save settings**.

Configure the Network Settings

1. From the home screen of the display select **Settings > General settings > Network**.

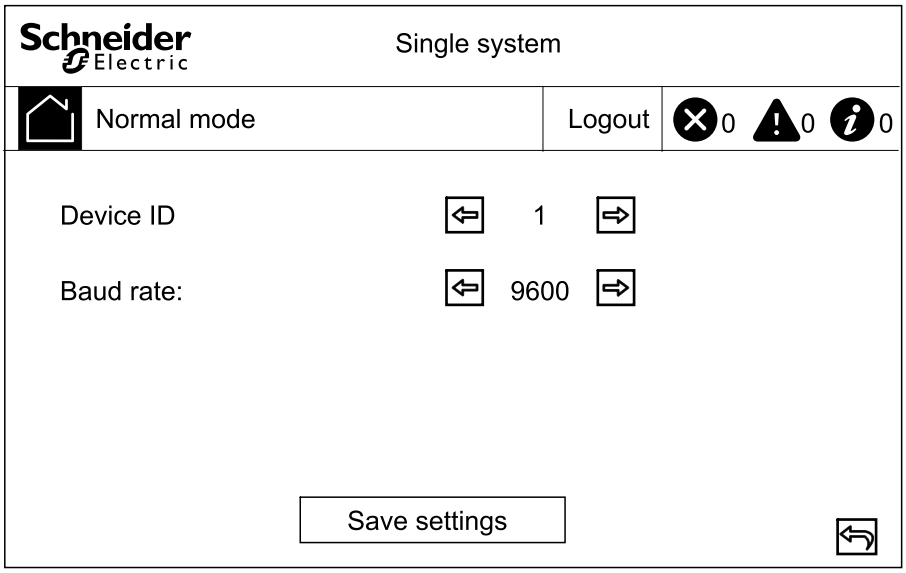

2. Set the **Device ID** for communication using the left and right arrows. Choose between 1-255.
3. Set the **Baud rate** for communication using the left and right arrows. Choose between 2400, 4800, 9600, 14400, and 19200.
4. Tap **Save settings**.

Change the Display Password

1. From the home screen of the display select **Settings > General settings > Password settings**.

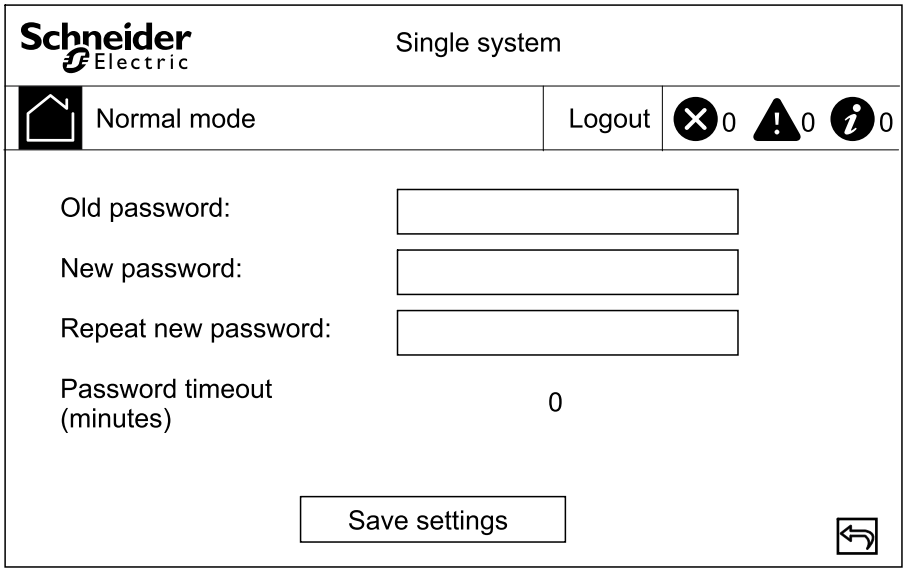

2. Type in **Old password**.
3. Type in **New password** and **Confirm new password**.
4. Set the time in minutes for automatic log out of the display after inactivity. Choose a value between 0 and 120.
5. Tap **Save settings**.

Set the Date and Time

1. From the home screen of the display select **Settings > General settings > Date and time**.

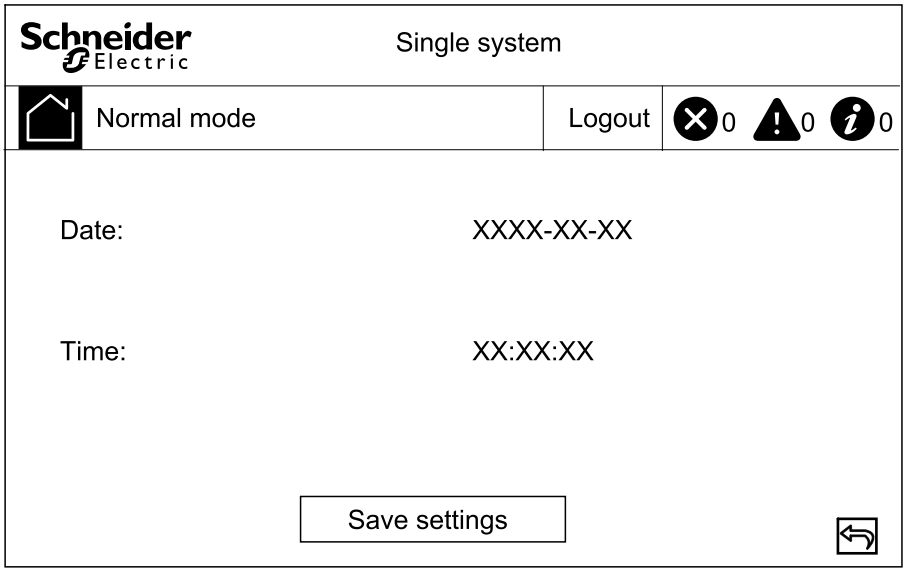

2. Set the **Date** using the keypad.
3. Set the **Time** using the keypad.
4. Tap **Save settings**.

Configure the UPS Settings

NOTICE
RISK OF EQUIPMENT DAMAGE Only trained personnel following the required training must make modifications to the UPS system parameters. **Failure to follow these instructions can result in equipment damage.**

1. From the home screen of the display select **Settings > Advanced settings > System settings**.

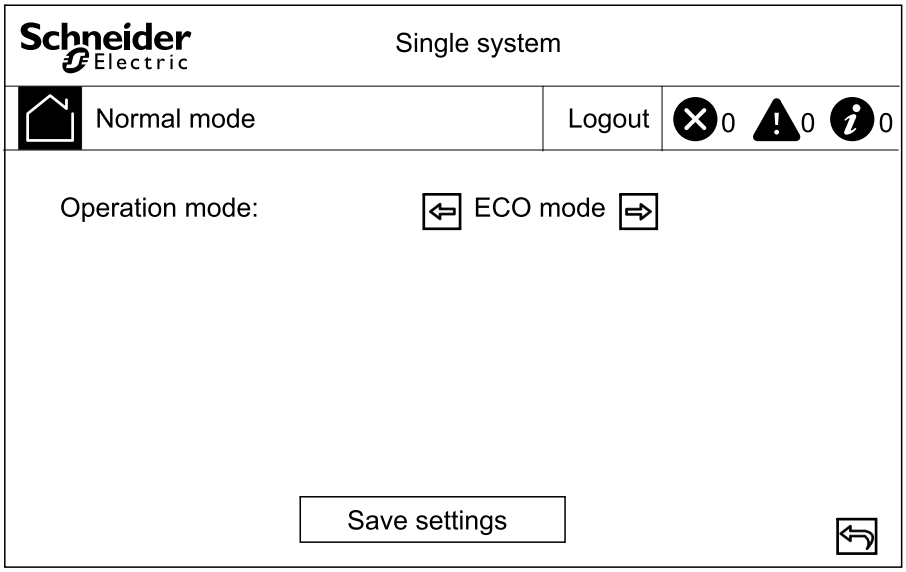

2. Set the System mode. Choose between:
   - Choose **ECO mode** to use static bypass mode as the preferred operation mode.
   - Choose **Single mode** for a single UPS.
3. Tap **Save settings**.

Configure the Output Settings

NOTICE

RISK OF EQUIPMENT DAMAGE

Only trained personnel following the required training must make modifications to the UPS system parameters.

Failure to follow these instructions can result in equipment damage.

1. From the home screen of the display select **Settings > Advanced settings > Output settings**.

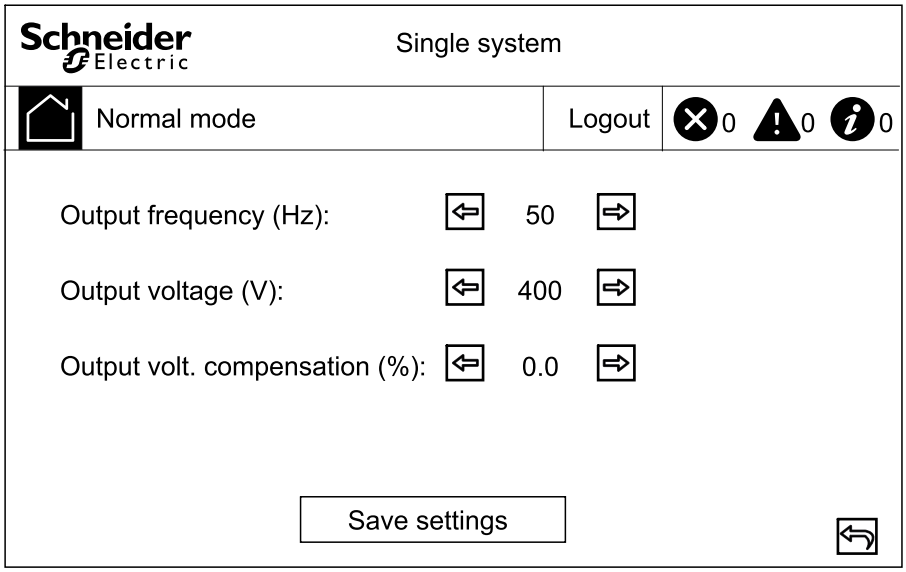

2. Set the **Output frequency (Hz)**. Choose between 50 and 60 Hz.
3. Set the **Output voltage (V)**. Choose between 380, 400, and 415 V.
4. Set the output voltage compensation (%). Choose a value between –5 and 5.
5. Tap **Save settings**.

Configure the Battery Settings

1. From the home screen of the display select **Settings > Advanced settings > Battery settings** and configure the following settings.

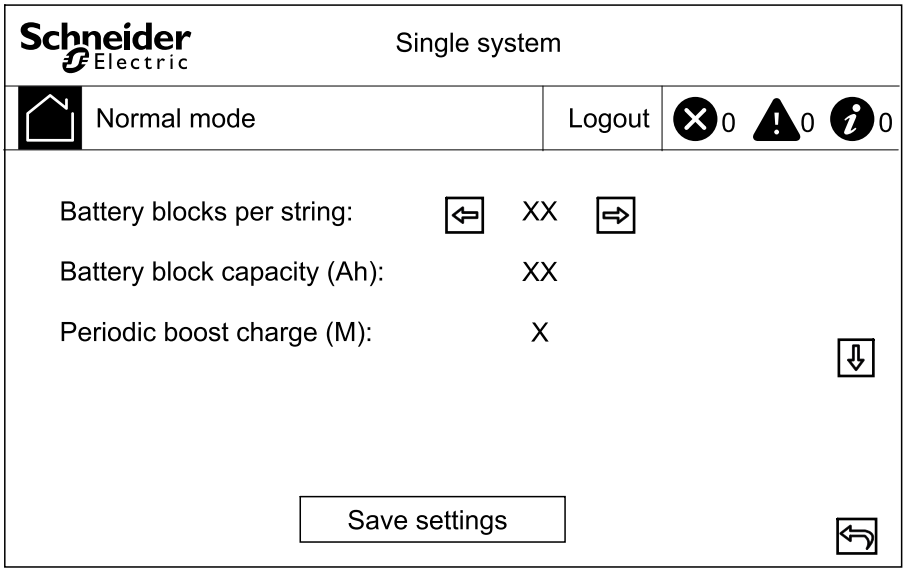

   a. **Battery blocks per string:** Set the number of battery blocks in one battery string.

   b. **Battery block capacity (Ah):** Set the rated capacity of the battery block.

   c. **Periodic boost charge (M):** Set the interval in months for changing from float charge to boost charge.

2. Tap arrow down and complete the following settings:

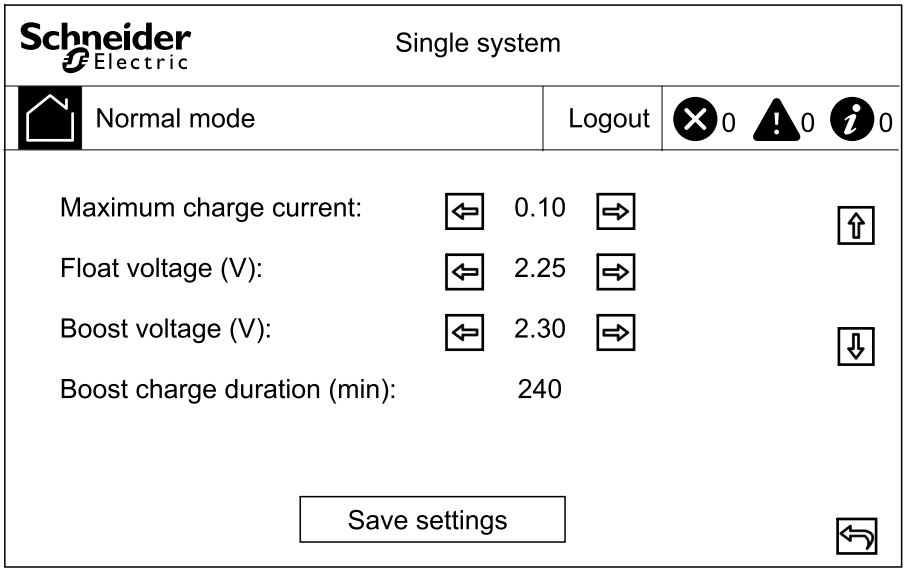

   a. **Maximum charge current:** Choose a value between 0.05 and 0.2 C.

   b. **Float voltage (V):** Choose a value between 2.20 and 2.29.

   c. **Boost voltage (V):** Set the upper limit for the boost charge voltage of a battery cell. Choose a value between 2.30 and 2.40.

   d. **Boost charge duration (minutes):** Set the duration of the boost charge. Choose a value between 0 and 999 minutes.

3. Tap arrow down and complete the following settings:

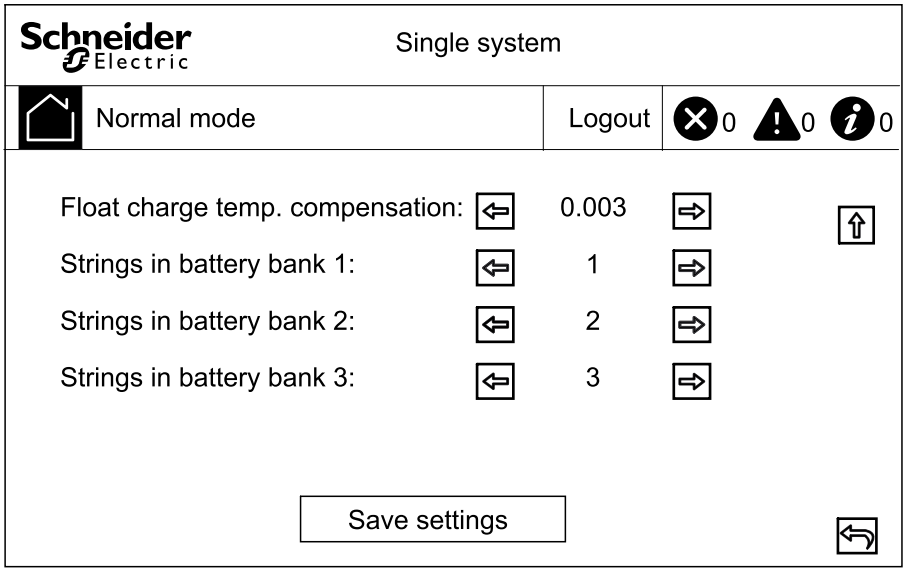

   a. **Float charge temp. compensation:** Choose a value between 0.000 and 0.007 V/°C per cell.

   b. **Strings in battery bank 1:** Select the number of battery strings in battery bank 1 (1-12 battery strings).

   c. **Strings in battery bank 2:** Select the number of battery strings in battery bank 2 (1-12 battery strings).

   d. **Strings in battery bank 3:** Select the number of battery strings in battery bank 3 (1-12 battery strings).

4. Tap **Save settings**.

Configure the Input Contacts and Output Relays

1. From the home screen of the display select **Settings > Advanced settings > Contacts and relays**.
2. Select **Enable** or **Disable** for the following features:
   - **Backfeed on input**
   - **Battery breaker trip**
   - **Backfeed on bypass**
   - **External MBB status**

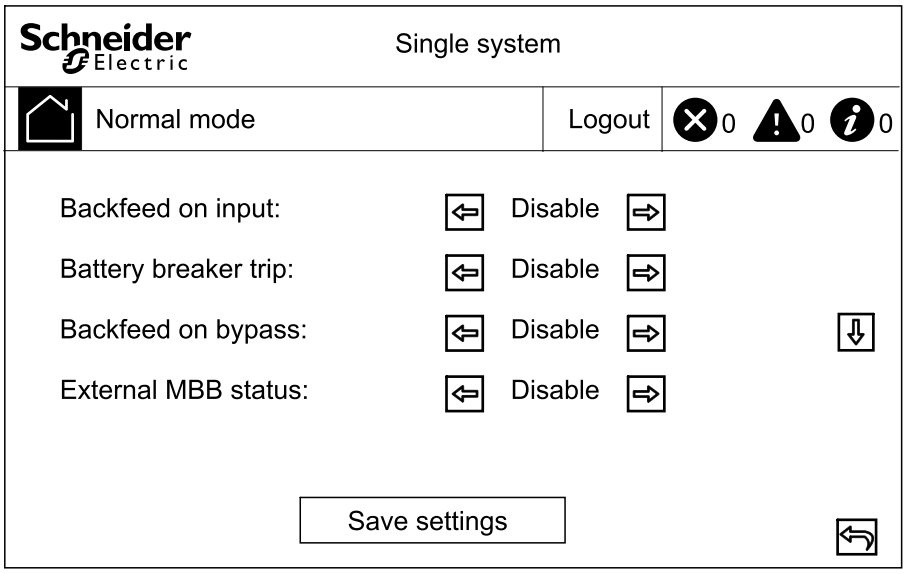

3. Tap arrow down and set the function for each of the configurable output relays. Note that there are two screens for output relays. Choose between:

- **Disable**
- **Common alarm**
- **In normal operation**
- **On battery**
- **Static bypass**
- **Maintenance bypass**
- **Output overload**
- **Charging**
- **Fan inoperable**
- **Battery inoperable**
- **Battery disconnected**
- **Battery voltage low**
- **Input out of tol.**
- **Bypass out of tol.**
- **EPO active**

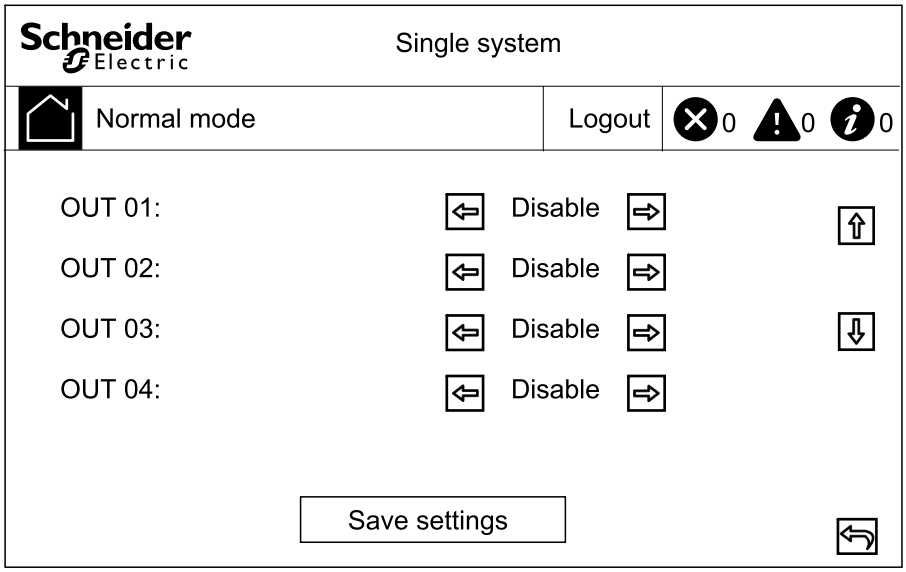

4. Tap arrow down and set the function for each of the configurable input contacts. Note that there are two screens for input contacts. Choose between:

   - **Disable**
   - **INV ON**
   - **INV OFF**
   - **Battery inoperable**
   - **Genset on**
   - **Custom alarm 3**
   - **Custom alarm 4**
   - **Disable ECO**
   - **Force INV OFF**
   - **Force charger OFF**

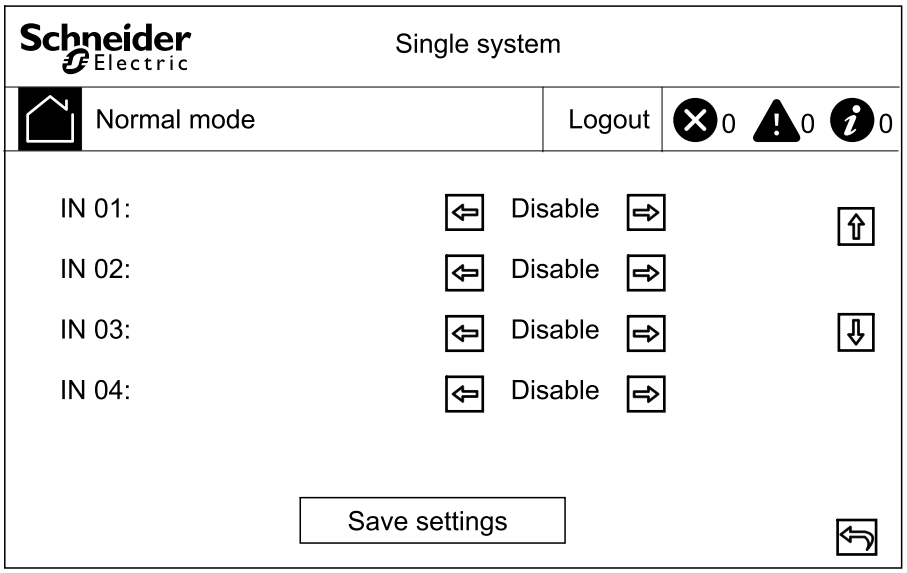

5. Tap **Save settings**.

Configure Life Cycle Monitoring

1. From the home screen of the display select **Service > LCM settings**.

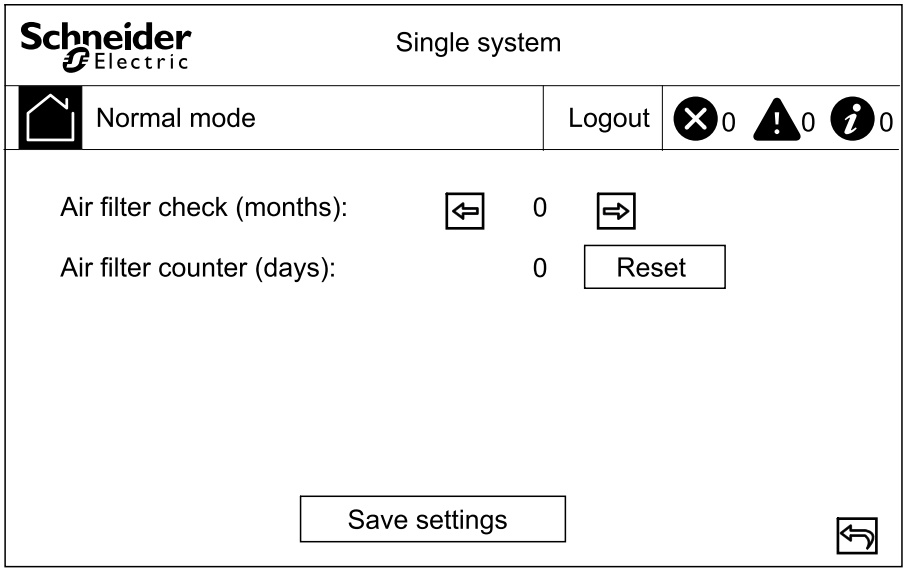

2. Set the time in months between air filter checks. The system will generate a **Check air filter** message when it is time to check the air filters.
3. Tap **Save settings**.

Enable/Disable Buzzer

1. From the home screen of the display select **Alarm(s)** and then select to either **Enable buzzer** or **Disable buzzer**.
2. Confirm your selection.

Maintenance

Parts Replacement

Determine if you need a Replacement Part

To determine if you need a replacement part, contact Schneider Electric and follow the procedure below so that the representative can assist you promptly:

1. In the event of an alarm condition, scroll through the alarm lists, record the information, and provide it to the representative.
2. Write down the serial number of the unit so that you will have it easily accessible when you contact Schneider Electric.
3. If possible, call Schneider Electric from a telephone that is within reach of the display so that you can gather and report additional information to the representative.
4. Be prepared to provide a detailed description of the problem. A representative will help you solve the problem over the telephone, if possible, or will assign a return material authorization (RMA) number to you. If a module is returned to Schneider Electric, this RMA number must be clearly printed on the outside of the package.
5. If the unit is within the warranty period and has been started up by Schneider Electric, repairs or replacements will be performed free of charge. If it is not within the warranty period, there will be a charge.
6. If the unit is covered by a Schneider Electric service contract, have the contract available to provide information to the representative.

Replace the Air Filter

1. Open the front door(s) of the UPS.

2. Remove the metal brackets from the rear of the door(s) and replace the air filters.

250-400 kVA UPS

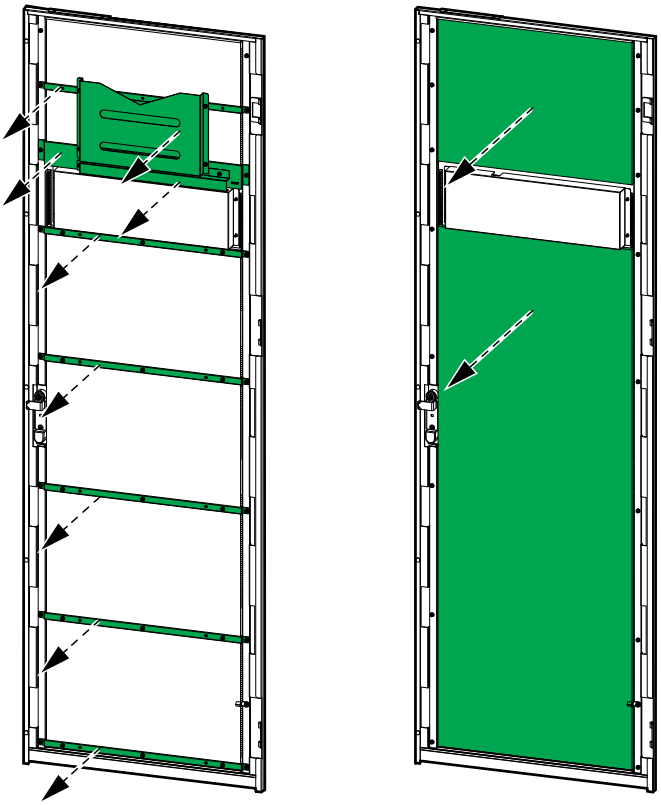

500-600 kVA UPS

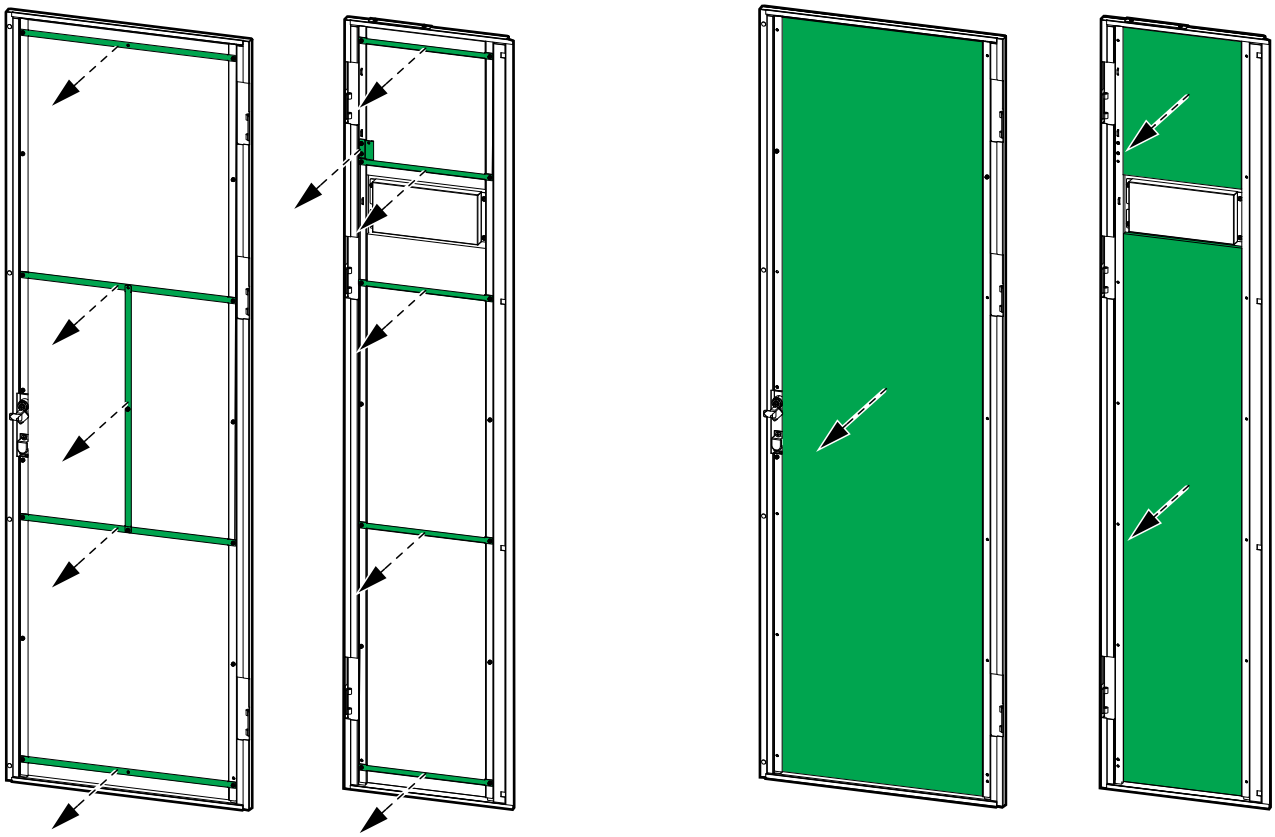

3. Reinstall the metal brackets and fasten with the screws.
4. Close the front door(s).

5. From the home screen of the display select **Service > LCM settings** and tap on the **Reset** button to reset the air filter counter.

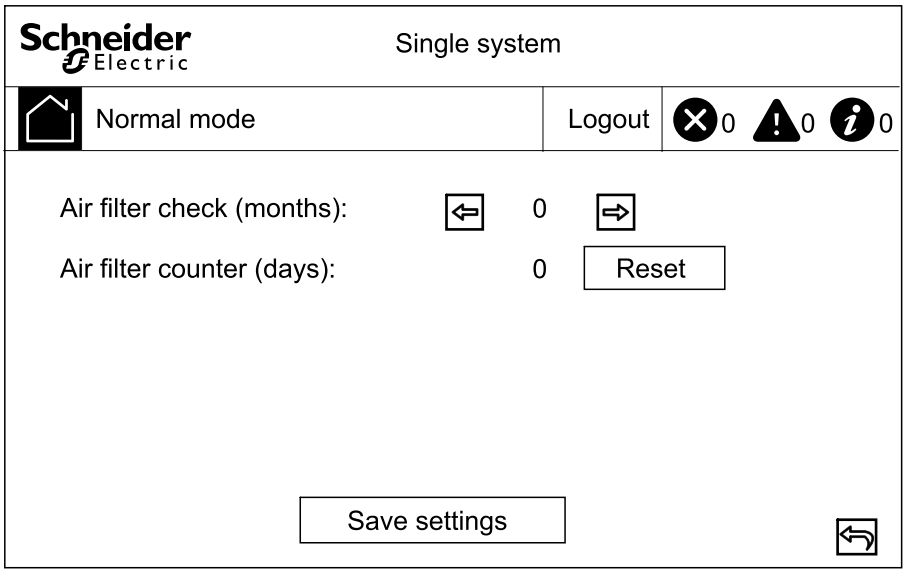

Troubleshooting

View the Active Alarms

1. From the home screen of the display select **Alarm(s) > Active alarm(s)**.

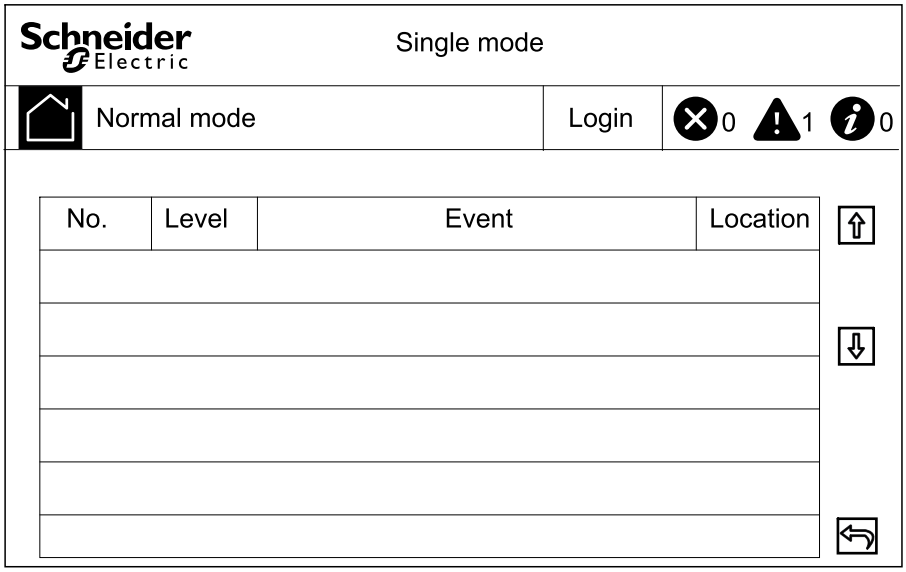

2. You can browse through the list of active alarms using the arrows.

Clear Alarm

1. Select **Control > Clear Alarm(s)** to clear the alarm list.

View the Log

1. From the home screen of the display select **Alarm(s) > Log**.

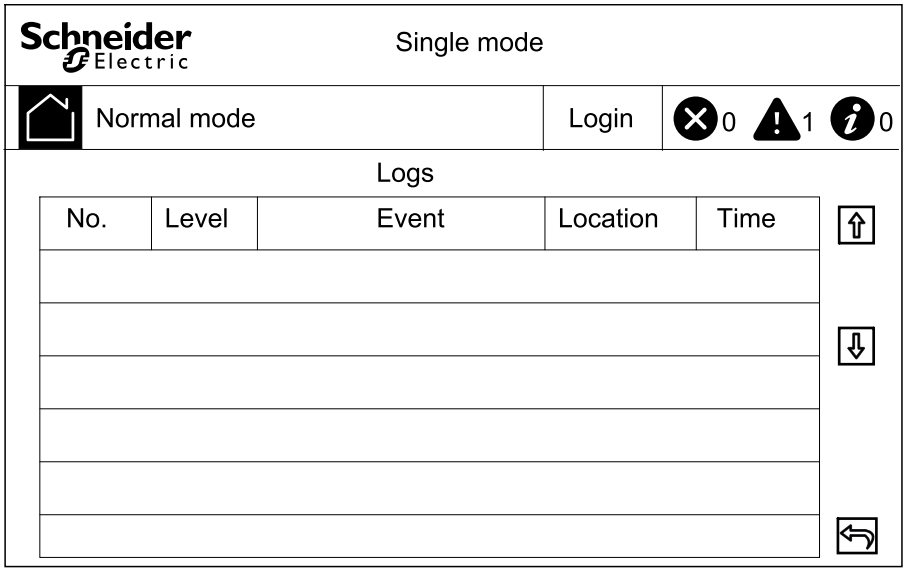

2. You can browse through the list of events using the arrows.

Calibrate the Display

1. Select **Service > Display calibration**.
2. Tap the crosses on the display to complete the calibration.

Schneider Electric
35 rue Joseph Monier
92500 Rueil Malmaison
France

+ 33 (0) 1 41 29 70 00

As standards, specifications, and design change from time to time, please ask for confirmation of the information given in this publication.

© 2020 – 2020 Schneider Electric. All rights reserved.

990-6287A-001